

RESOLUTION NO 2318**A RESOLUTION OF THE CITY COUNCIL OF THE CITY OF SOLEDAD
APPROVING PLANS AND AUTHORIZING THE CITY MANAGER
TO ACCEPT BIDS FROM SANCO PIPELINES, INC. FOR
THE INSTALLATION OF AN EIGHT INCH RECLAIMED
WATER LINE SEGMENT FROM THE WASTEWATER
TREATMENT PLANT TO THE SOUTHERN
PACIFIC RAILROAD TRACKS**

WHEREAS, the City of Soledad has received funding from the State of California through the Community Development Block Grant Economic Development (CDBG) Program for providing sewer services to the new Dole Fresh Vegetable Plant; and,

WHEREAS, the Monterey County Water Resources Agency has adopted a Water Conservation Plan for the Salinas Valley; and,

WHEREAS, the City of Soledad has adopted a Water Conservation Plan; and,

WHEREAS, the City of Soledad's General Plan calls for the reuse of water; and,

WHEREAS, the City of Soledad Planning Commission has approved and submitted a General Plan Consistency report to the City Council for the proposed project; and,

WHEREAS, Monterey County as the lead Agency has certified a Negative Declaration for construction of an 18" sewer force main from the Wastewater Treatment Plant to the Correctional Training Facility and has determined no further environmental review is required, additionally construction is underway on the force main project; and,

WHEREAS, a mandatory pre-bid conference was held on February 7, 1994 with Sanco Pipelines, Inc., being the only bidder present and submitting a bid of \$58,710.

NOW THEREFORE BE IT RESOLVED, that the City Council of

Page 2

PASSED AND ADOPTED by the City Council of the City of Soledad at a regular meeting duly held on the 28th day of February, 1994, by the following vote:

AYES, and in favor thereof, Councilmembers: John Holguin, Ben Jimenez, Jr., Richard Ortiz, Mayor Pro Tem Fabian Barrera, Mayor Fred Ledesma

NAYES, Councilmembers: None

ABSENT, Councilmember: None


Handwritten signature of Paul K. ...

MAYOR OF THE CITY OF SOLEDAD


ATTEST:

Handwritten signature of the City Clerk

CITY CLERK OF THE CITY OF SOLEDAD

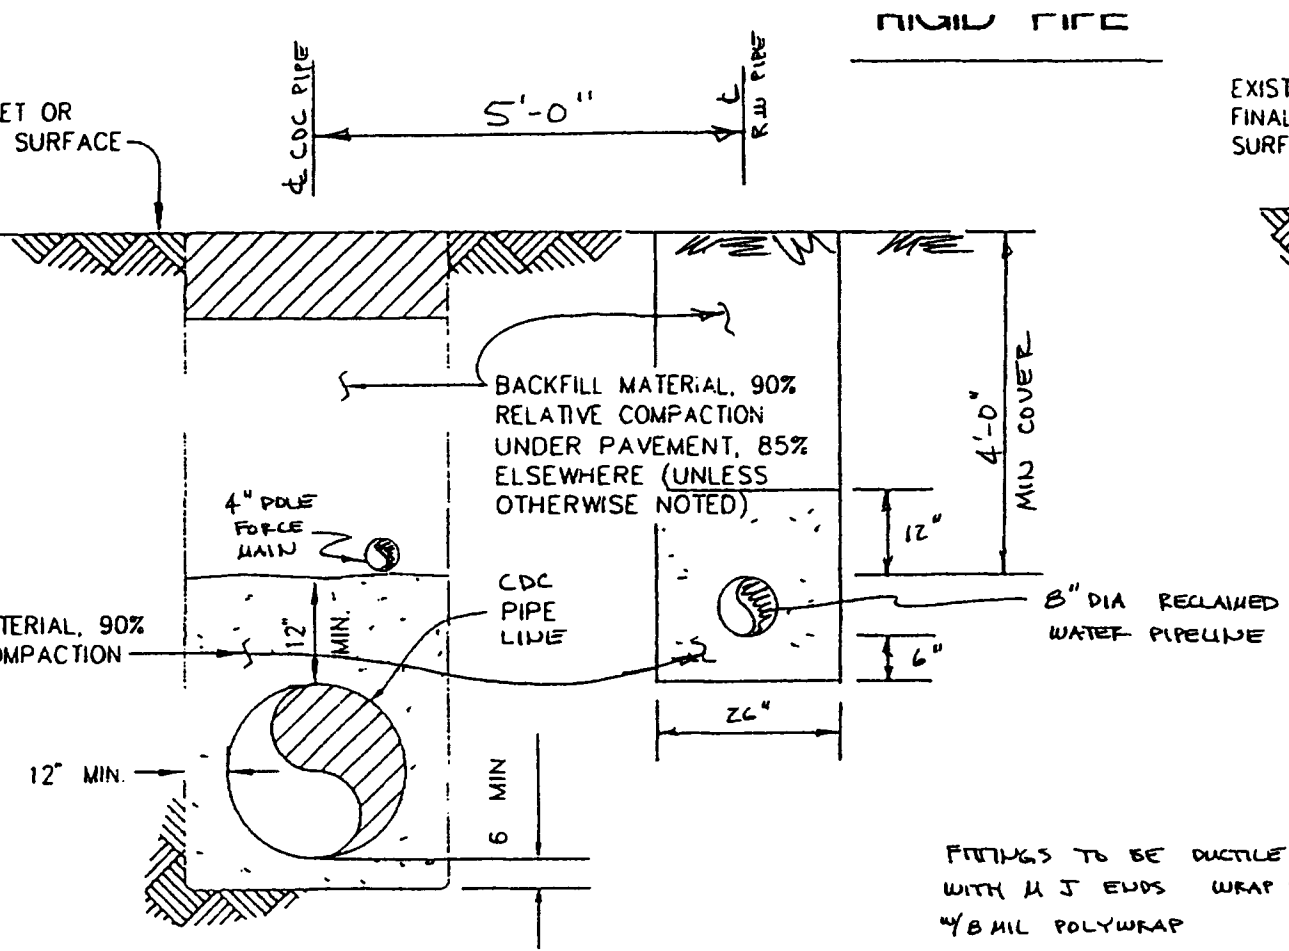

RIGID PIPE

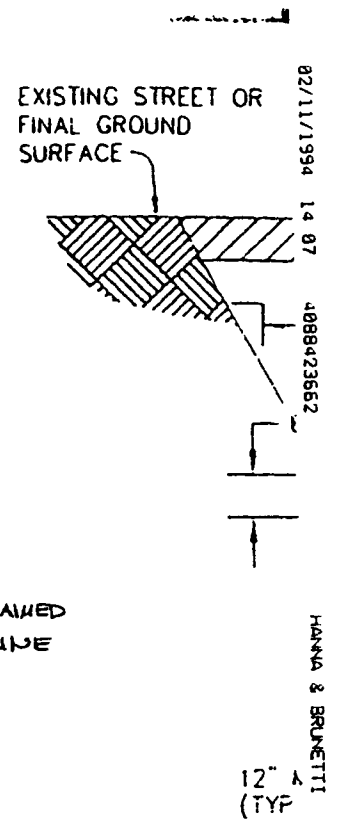

FITTINGS TO BE DUCTILE IRON, 550 PSI
 WITH M J ENDS WRAP D I FITTINGS
 1/8 MIL POLYWRAP

VERTICAL WALL TRENCH DETAIL

NOT TO SCALE
 SECTION A-A

TYPICAL

PAGE 01
 NOTES

FLEXIBLE PIPE


PAGE 02

HANNA & BRUNETTI

4088423662

14 03

02/11/1994

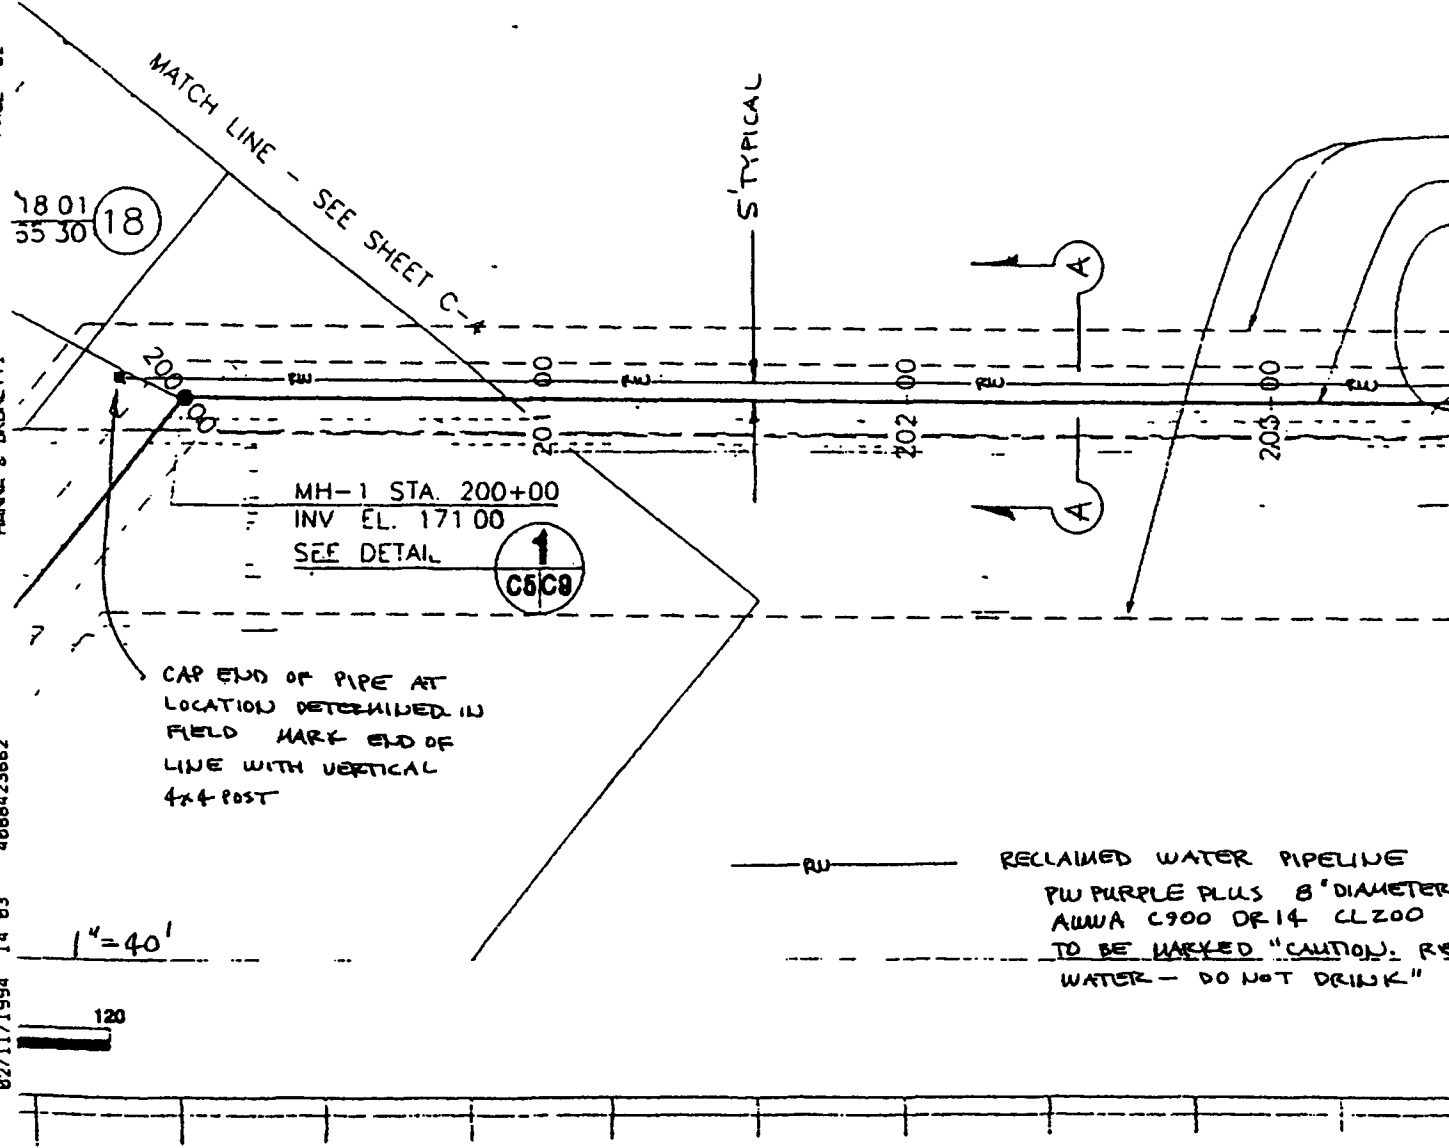

78 01
55 30 (18)

MATCH LINE - SEE SHEET C-4

TYPICAL

MH-1 STA. 200+00
INV. EL. 171.00
SEE DETAIL

1
C5C9

CAP END OF PIPE AT
LOCATION DETERMINED IN
FIELD MARK END OF
LINE WITH VERTICAL
4x4 POST

RW RECLAIMED WATER PIPELINE
PW PURPLE PLUS 8" DIAMETER
AWWA C900 OR 14" CL200
TO BE MARKED "CAUTION. RE
WATER - DO NOT DRINK"

1" = 40'

120